




PERPENDICULAR CURB RAMPS (TYPE 1)

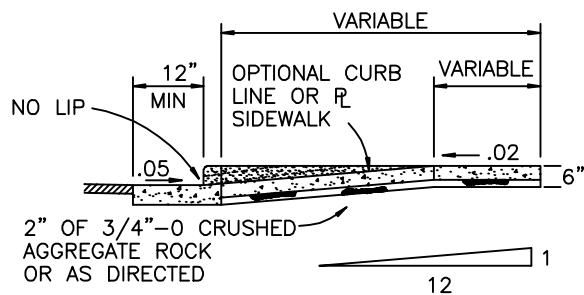

TYP. SECTION THROUGH DETAIL

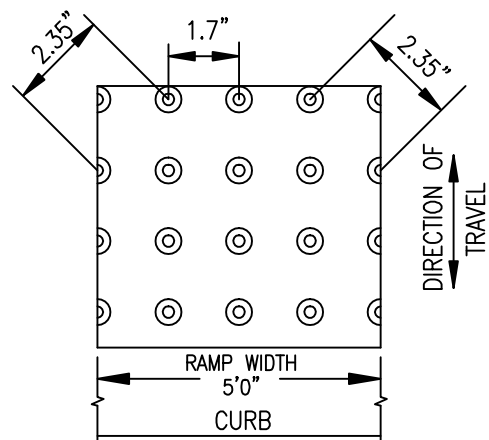


RAMP TEXTURE PATTERN DETAIL

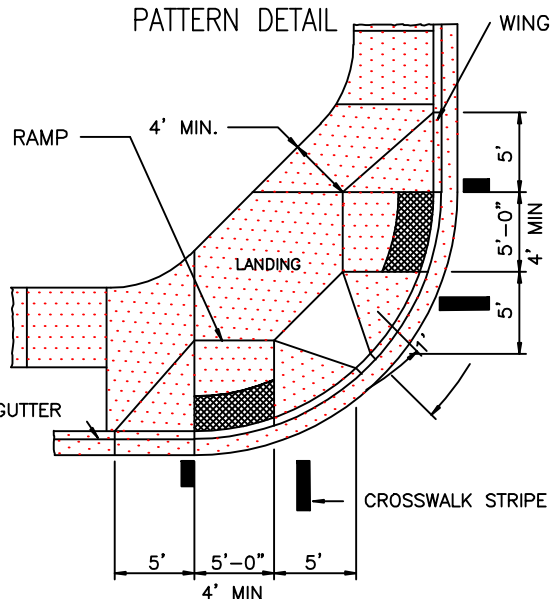

PERPENDICULAR CURB RAMPS (TYPE 2)

NOTES:

1. THE "AMERICANS WITH DISABILITIES ACT" REQUIRES THAT ACCESS RAMPS TO SIDEWALKS CONFORM TO ALL FEDERAL GUIDELINES. EXCEPTIONS TO THE REQUIREMENTS IN THIS DRAWING MUST BE APPROVED BY THE ENGINEER AND MUST COMPLY WITH ADA.
2. NO ABOVE GROUND UTILITIES ARE PERMITTED WITHIN RAMP AREA.
3. LANDINGS SHALL BE PLACED AT THE TOP OF EACH RAMP. LANDING SLOPES SHALL NOT EXCEED 50:1 IN ANY DIRECTION. 5% SLOPED LANDING (MAX.) SHALL BE PLACED AT THE BOTTOM OF EACH RAMP.
4. MINIMUM LANDING DIMENSIONS SHALL BE 4' x 4'.
5. CONCRETE STRENGTH SHALL BE 3300 PSI.

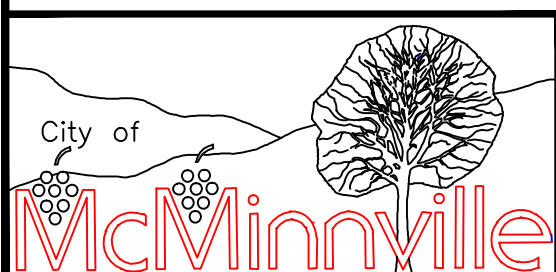

DETAIL FOR SIDEWALK ACCESS RAMPS

DATE:
AUGUST 2009

DRAWING NO.
1